


WWTP Headworks



Problems with the Headworks –

- Electrical work is within the enclosed, non-vented area where sewage passes resulting in corrosion of electrical cabinets, hardware and conduit. (Sanitary sewage produces acidic vapors.)
- *Auger Monster* that removes “solids” from waste stream is worn out and does a poor job of removal.
- No backup to single *Auger Monster* that is often down for maintenance, except a manual bar screen that is labor intensive and prone to clogging.
- Collection of removed solids requires manual loading of waste into transport containers

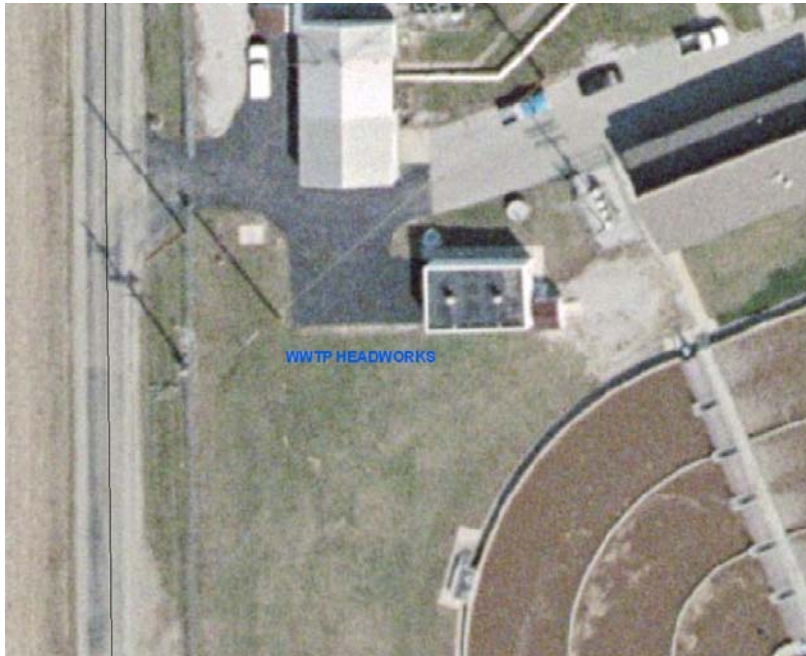